

SOUTHERN NEVADA BUILDING OFFICIALS
REGIONAL STANDARDS

E-105

7-7-14

PG. 1 OF 1


TEMP. CONST. POWER THROUGH MAIN ELECT.-BLDG. SRVC SINGLE FAM. DWELLINGS

Clark County
Dept. of Building & Fire Prevention
4701 W Russell Rd
Las Vegas, NV 89118
(702) 455-3000

Boulder City
Building Department
401 California Avenue
Boulder City, NV 89005
(702) 293-9282

Henderson
Bldg & Fire Safety Dept.
240 Water Street
Henderson, NV 89015
(702) 267-3650

Las Vegas
Building & Safety Dept.
333 N. Rancho Drive
Las Vegas, NV 89106
(702) 229-6251

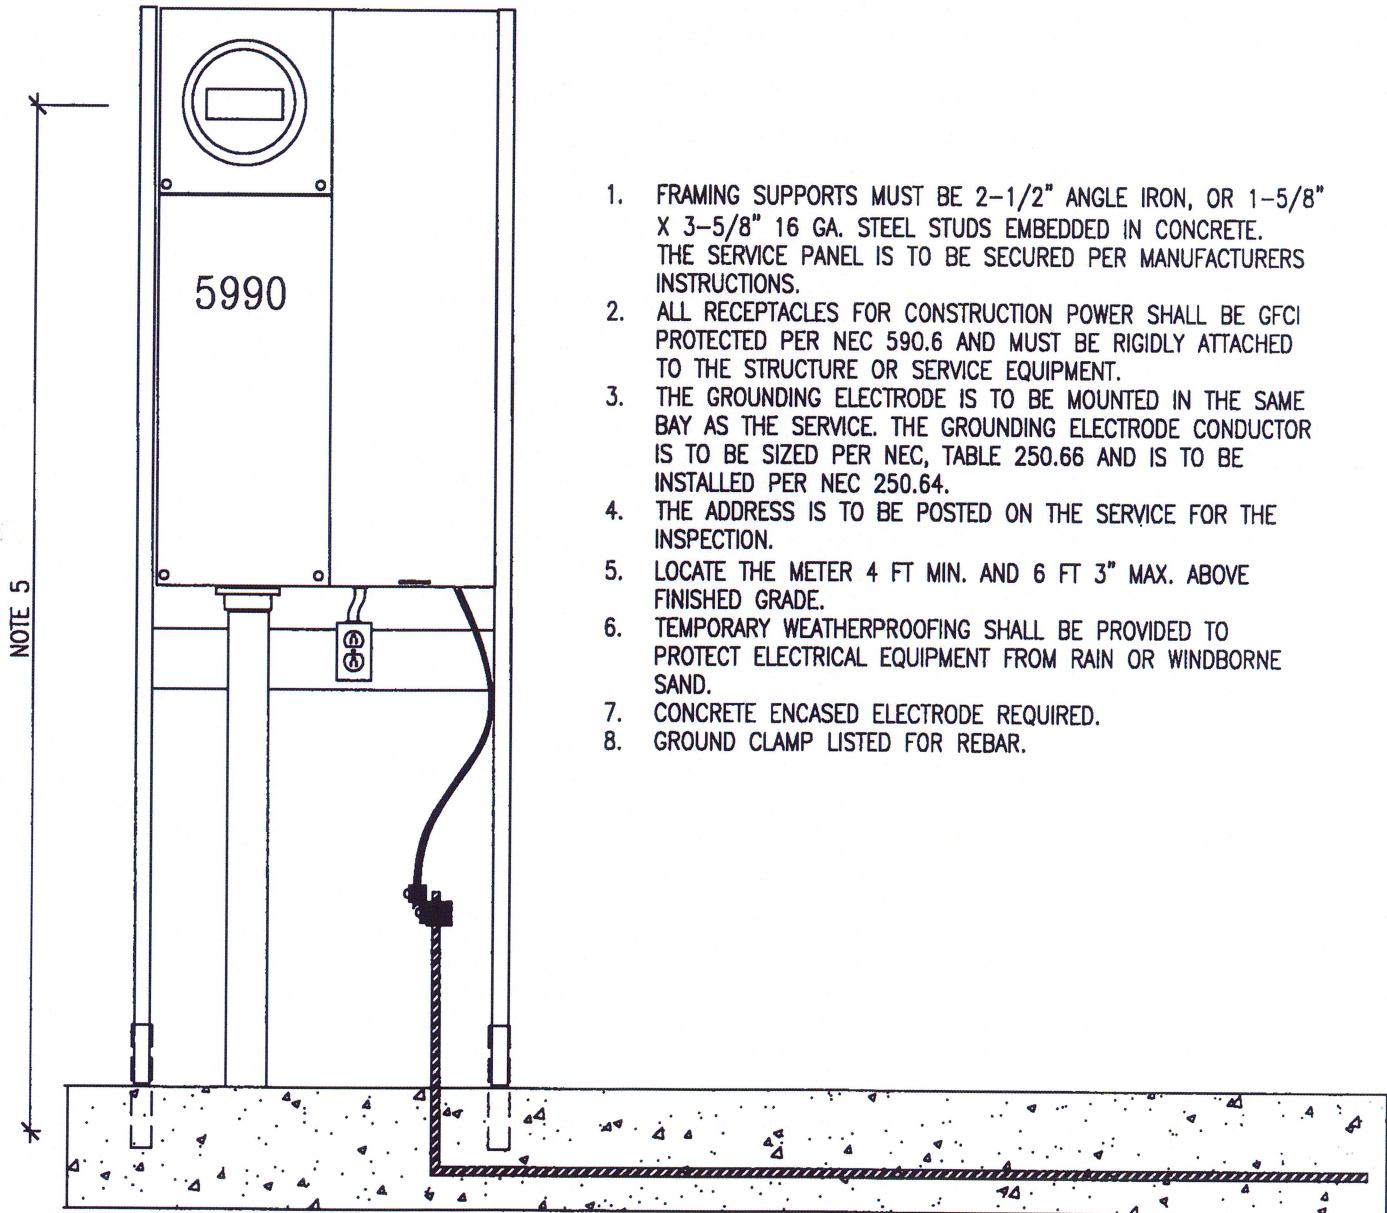

1. FRAMING SUPPORTS MUST BE 2-1/2" ANGLE IRON, OR 1-5/8" X 3-5/8" 16 GA. STEEL STUDS EMBEDDED IN CONCRETE. THE SERVICE PANEL IS TO BE SECURED PER MANUFACTURERS INSTRUCTIONS.
2. ALL RECEPTACLES FOR CONSTRUCTION POWER SHALL BE GFCI PROTECTED PER NEC 590.6 AND MUST BE RIGIDLY ATTACHED TO THE STRUCTURE OR SERVICE EQUIPMENT.
3. THE GROUNDING ELECTRODE IS TO BE MOUNTED IN THE SAME BAY AS THE SERVICE. THE GROUNDING ELECTRODE CONDUCTOR IS TO BE SIZED PER NEC, TABLE 250.66 AND IS TO BE INSTALLED PER NEC 250.64.
4. THE ADDRESS IS TO BE POSTED ON THE SERVICE FOR THE INSPECTION.
5. LOCATE THE METER 4 FT MIN. AND 6 FT 3" MAX. ABOVE FINISHED GRADE.
6. TEMPORARY WEATHERPROOFING SHALL BE PROVIDED TO PROTECT ELECTRICAL EQUIPMENT FROM RAIN OR WINDBORNE SAND.
7. CONCRETE ENCASED ELECTRODE REQUIRED.
8. GROUND CLAMP LISTED FOR REBAR.

Mesquite
Building Department
10 East Mesquite Blvd.
Mesquite, NV 89027
(702) 346-2835

North Las Vegas
Building Department
2250 Las Vegas Blvd. N
N. Las Vegas, NV 89030
(702) 633-1577

Pahrump
Building & Fire Safet Dept.
250 N Hwy 160 Suite #3
Pahrump, NV 89060
(775) 751-3373